



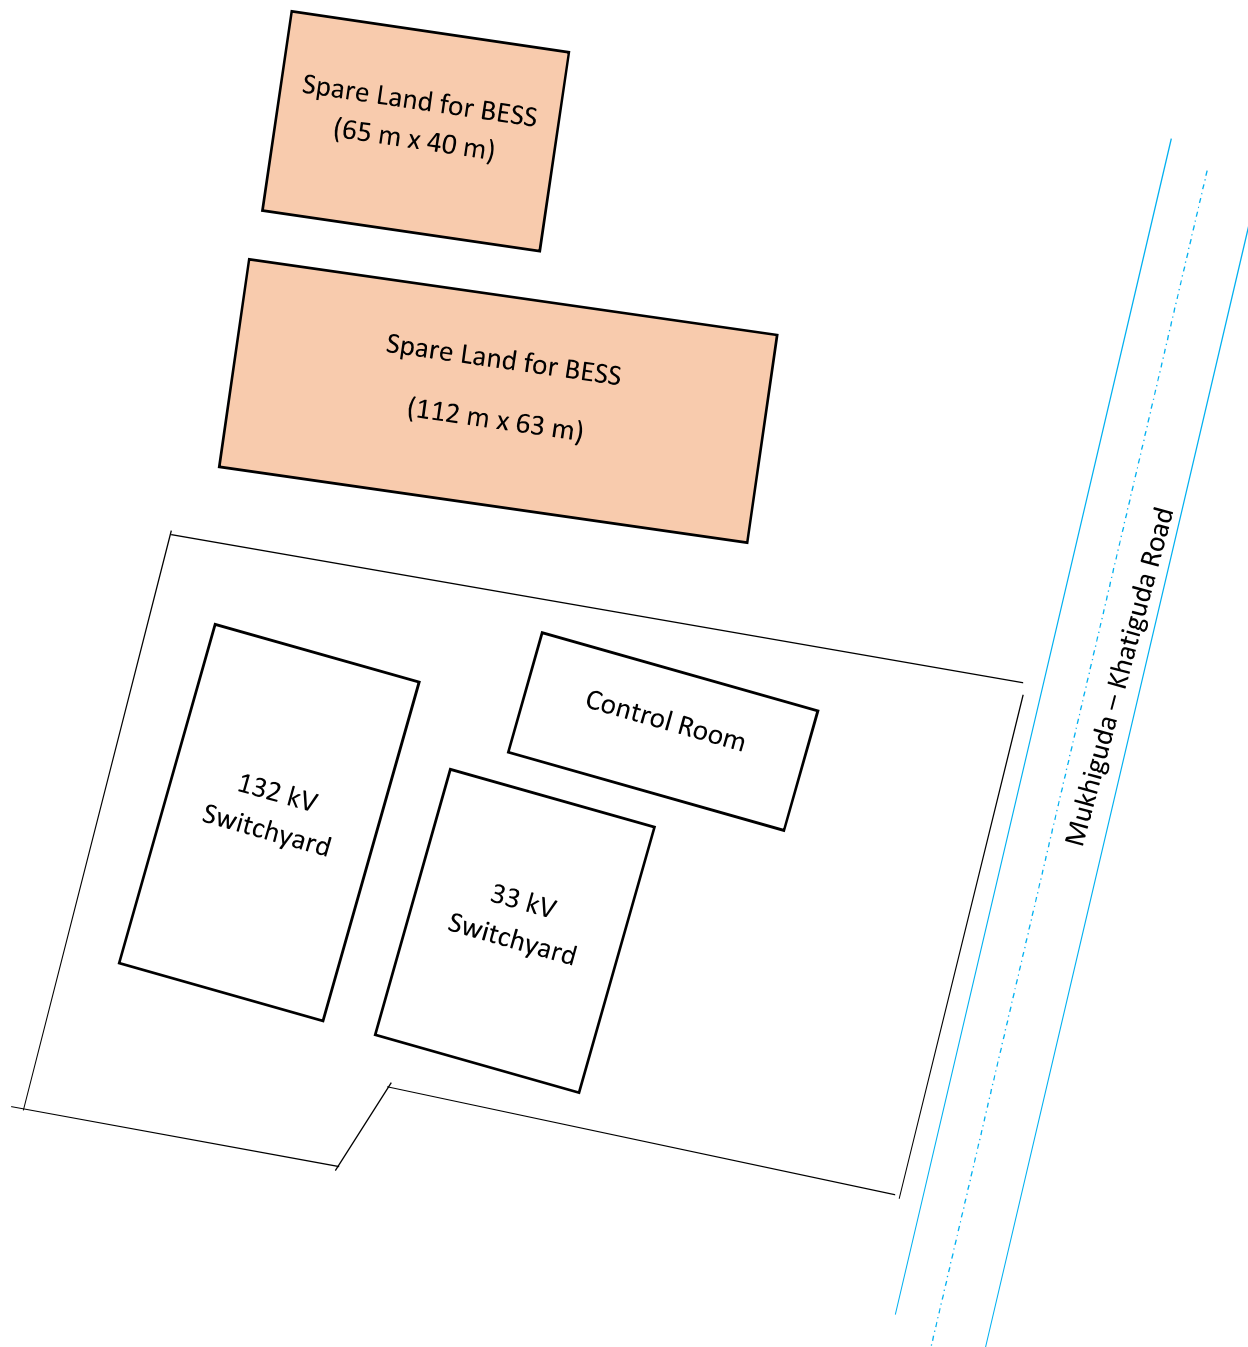

**Layout of 132/33 kV Grid Substation, Tentulikhunti**

- Not to Scale

C1-800-400-200/1-1-1-A  
 C2-800-400-200/1-1-1-A  
 C3-800-300-150/1-1-1-A  
 C4-400-200-100/1-1-1-A  
 C5-400-200-100/1-1-1-A  
 C6-400/1-1-1-A  
 A - ALIND  
 AR - AREVA  
 S - BH&L  
 CGL - CROMPTON GREAVES LTD.  
 ES - EASTERN SWITCHGEARS  
 S - SIEMENS  
 SS - SWITCHGEAR & STRUCTURALS LTD.  
 SC - SCHNIDER  
 GE - GENERAL ELECTRIC  
 VTS - VISHAL TRANSFORMERS & SWITCHGEARS

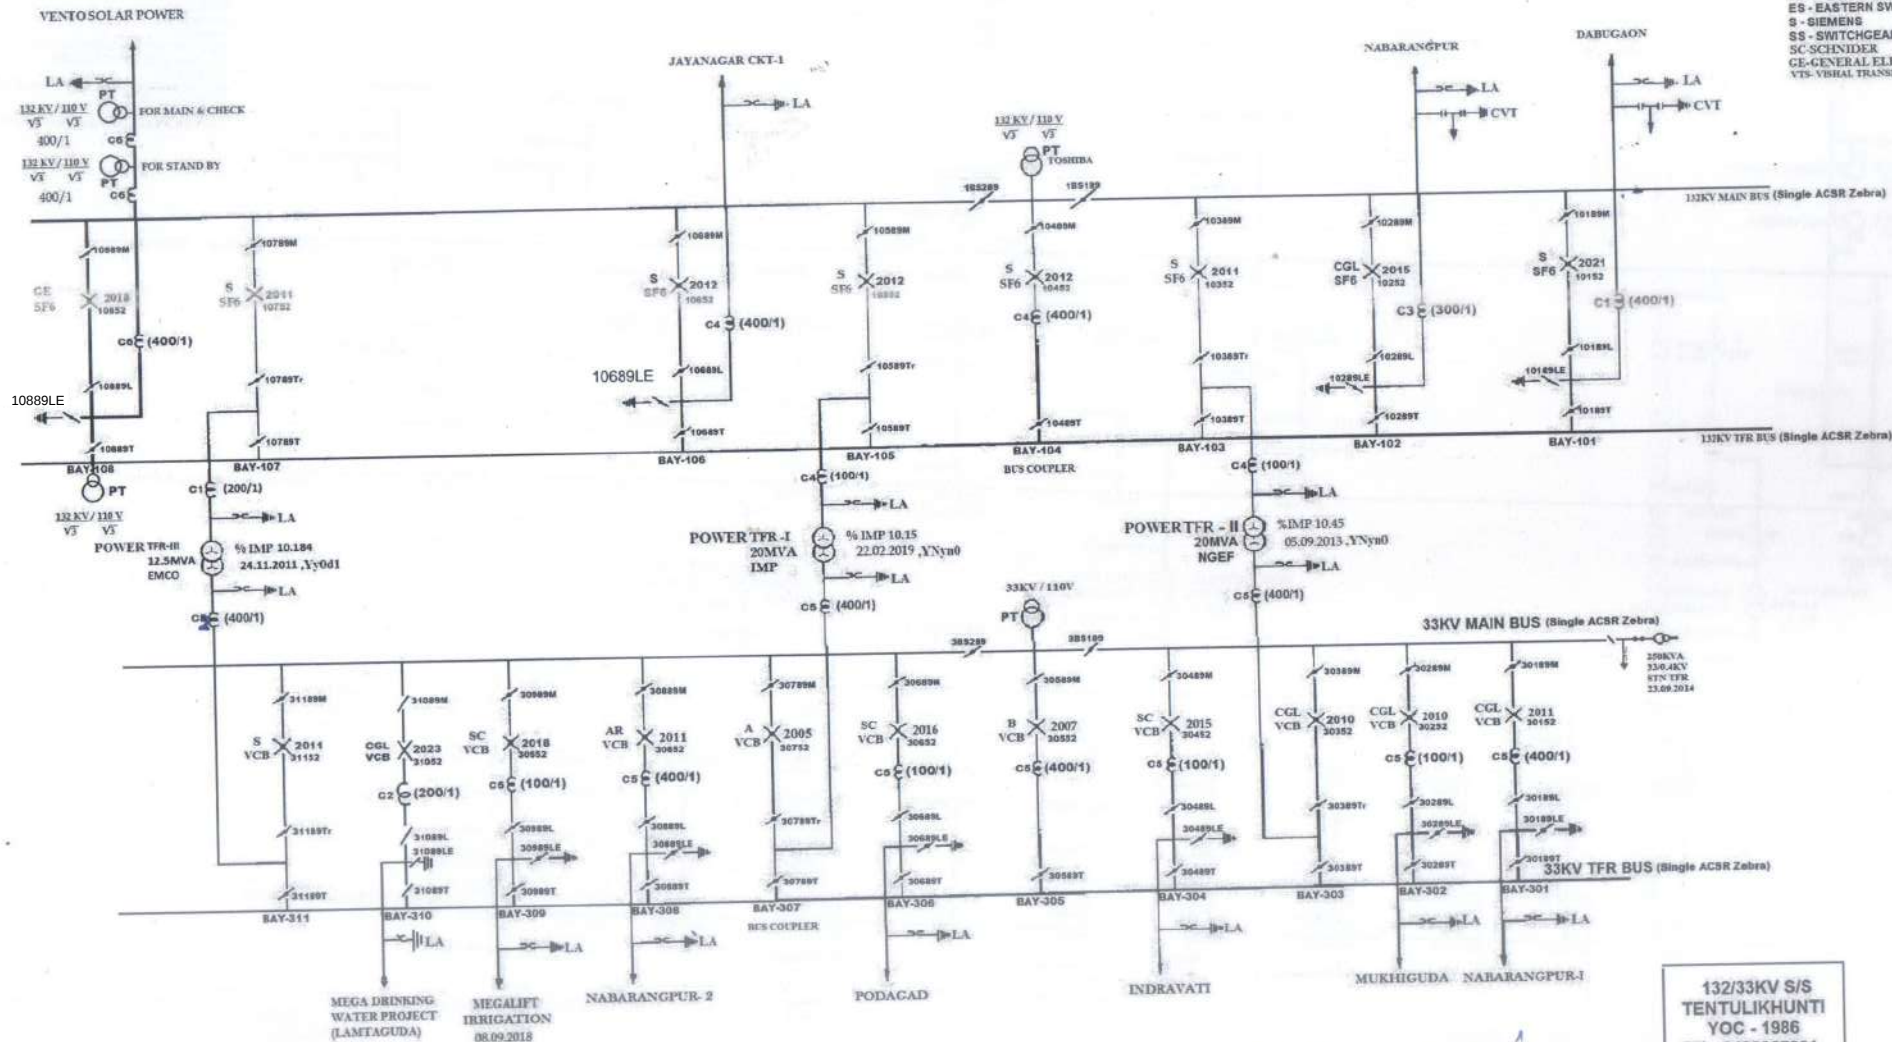

S. Sarangi  
 SUB DIVISIONAL OFFICER (ELECT)  
 132 KV TL S/S SUB DIVISION  
 OPTCL TENTULIKHUNTI